

**PMG LISTING CRITERIA FOR  
CONDUCTIVE JACKETED CORRUGATED STAINLESS STEEL  
TUBING UTILIZING ARC-RESISTANT  
PROTECTIVE JACKETS**

LC1024

Approved February 2010  
(Revised April 2010)

## PREFACE

Plumbing, mechanical and fuel gas (PMG) listings issued by ICC Evaluation Service, Inc. (ICC-ES), are based upon performance features of the *International Plumbing Code*®, *International Mechanical Code*®, *International Residential Code*®, *Uniform Plumbing Code* and *Uniform Mechanical Code*. Section 105.2 of the *International Plumbing Code*® reads as follows:

**Alternative materials, methods and equipment.** The provisions of this code are not intended to prevent the installation of any material or to prohibit any method of construction not specifically prescribed by this code, provided that any such alternative has been approved. An alternative material or method of construction shall be approved where the code official finds that the proposed design is satisfactory and complies with the intent of the provisions of this code, and that the material, method or work offered is, for the purpose intended, at least the equivalent of that prescribed in this code in quality, strength, effectiveness, fire resistance, durability and safety.

Similar provisions are contained in the Uniform Codes.

ICC-ES may consider alternate listing criteria, provided the listing applicant submits valid data demonstrating that the alternate listing criteria are at least equivalent to the listing criteria set forth in this document, and otherwise demonstrate compliance with the performance features of the codes. Notwithstanding that a product, material, or type or method of construction meets the requirements of the criteria set forth in this document, or that it can be demonstrated that valid alternate criteria are equivalent to the criteria in this document and otherwise demonstrate compliance with the performance features of the codes, ICC-ES retains the right to refuse to issue or renew a listing, if the product, material, or type or method of construction is such that either unusual care with its installation or use must be exercised for satisfactory performance, or if malfunctioning is apt to cause unreasonable property damage or personal injury or sickness relative to the benefits to be achieved by the use of the product, material, or type or method of construction.

***Listing criteria are developed solely for use by ICC-ES for purposes of issuing ICC-ES PMG listings.***

## 1.0 INTRODUCTION

**1.1 Purpose:** The purpose of this listing criteria is to establish the effectiveness of a protective special exterior jacket material factory-applied to corrugated stainless steel tubing (CSST) which is currently recognized as code-complying in another ICC-ES PMG listing report. The exterior jacket material is intended to protect the inner CSST from leakage due to transient arcing from exposure to lightning voltage/currents that may exist inside a building; utilize the appliance bond as the sole bonding method; and be recognized in an ICC Evaluation Service, Inc. (ICC-ES) listing. This listing criteria addresses a proposed level of arcing from lightning, not a direct strike.

**1.2 Scope:** This listing criteria defines test methods and performance requirements applicable for evaluating simulated indirect lightning resistance of a protective special exterior jacket material factory-applied over a CSST which is currently recognized in an ICC-ES PMG listing. The lightning-resistant CSST system, for use in fuel gas piping, is intended for use in normal installations when installed in compliance with the manufacturer's instructions and with Sections 309 and 310 of the *International Fuel Gas Code*® and Sections G2410 and G2411 of the *International Residential Code*®.

### 1.3 Codes and Referenced Standards:

Note: Any standard referenced herein shall be the current edition of that standard.

**1.3.1** 2006 and/or 2009 *International Residential Code*® (IRC), Chapter 24, Fuel Gas, International Code Council.

**1.3.2** 2006 and/or 2009 *International Fuel Gas Code*® (IFGC), International Code Council.

**1.3.3** 2006 and/or 2009 *Uniform Plumbing Code*™ (IAPMO UPC), Chapter 12, Fuel Gas Piping, International Association of Plumbing and Mechanical Officials.

**1.3.4** 2006 and/or 2009 *Uniform Mechanical Code*™ (IAPMO UMC), Chapter 13, Fuel Gas Piping, International Association of Plumbing and Mechanical Officials.

**1.3.5** ANSI LC 1 / CSA 6.26, Fuel Gas Piping Systems Using Corrugated Stainless Steel Tubing (CSST) Fuel Gas. American National Standards Institute.

## 2.0 BASIC INFORMATION

The following basic information shall be provided:

**2.1 Product Description:** The product consists of corrugated stainless steel tubing (CSST) and brass fittings for fuel gas piping systems recognized in another current ICC-ES PMG listing as conforming

30 to ANSI LC 1 / CSA 6.26, and satisfying the referenced codes listed in Section 1.3, but, with a  
31 different covering. The CSST is covered with an electrically conductive protective jacket.

32 **2.2 Installation Instructions:** The product shall be installed in accordance with the manufacturer's  
33 instructions and the requirements of the applicable codes and referenced standards listed in Section  
34 1.3.

35 **2.3 Product and Packaging Identifications:** The unit and the package shall be permanently and legibly  
36 marked with the manufacturer's name or trademark, and the model number. The product shall also  
37 bear the ICC-ES PMG listing mark. The ICC-ES listing number shall be placed on the listed product's  
38 packaging or installation instructions.

### 39 **3.0 GENERAL REQUIREMENTS**

40 **3.1 Corrugated Stainless Steel Tubing:** Corrugated stainless tubing shall be currently recognized in an  
41 ICC-ES PMG listing as complying with the requirements of ANSI LC 1 / CSA 6.26.

42 **3.2 Electrically Conductive Protective Jacket:** The product shall be tested in accordance with Section  
43 4.0 of this standard.

### 44 **4.0 TEST METHOD AND PERFORMANCE REQUIREMENTS**

45 **4.1 Testing:** Testing shall be performed by an International Accreditation Service (IAS) recognized  
46 lightning testing laboratory or by a signatory to a Mutual Recognition Agreement to which IAS is a  
47 signatory.

48 **4.2 Specimen Conditioning:** The specimen used for testing shall be previously subjected to a 96-hr  
49 corrosion test conducted in accordance with ASTM B117. The specimen must include the protective  
50 jacket on a section of CSST and be joined to a fitting in accordance with the manufacturer's  
51 installation instructions.

52 **4.2 4.3 Test Wave Forms:** The waveform is defined by its rise-time to peak current and fall-time to 50%  
53 of peak amplitude. The applied current wave form shall be 10 micro sec x 1,000 micro sec  
54 determined by the lightning laboratory, and shall be representative of induced lightning effects that  
55 could appear on gas piping inside a building. For the purposes of this listing criteria, the assumed  
56 energy associated with a transient arc inside a building is less than two coulombs and the recognized  
57 CSST system must resist a minimum of 4.5 coulombs, which includes a factor of safety in excess of  
58 2, when tested as noted in this listing criteria. A typical current wave form is shown in Figure 1.

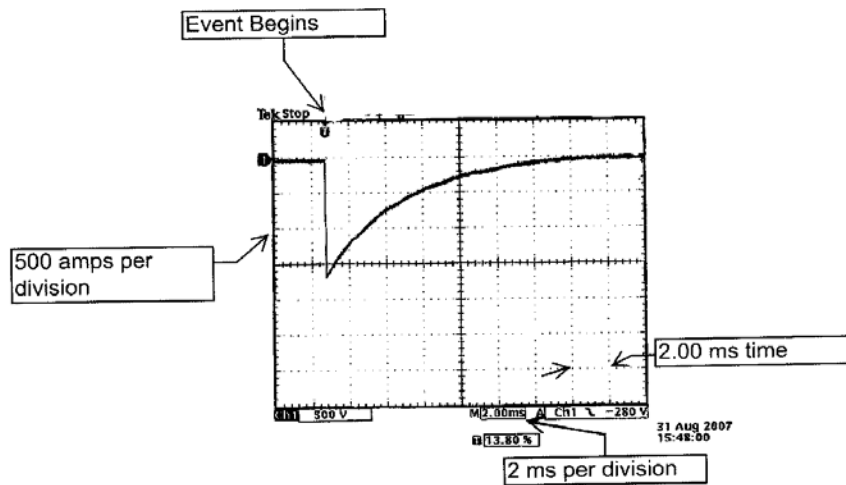


FIGURE 1—TYPICAL CURRENT WAVE FORM

**4.3.4.4 Test Procedures:** The procedures noted below shall be used to evaluate the performance of CSST piping. Testing shall be conducted on two samples each of the smallest, largest and an intermediate diameter tubing to qualify all sizes. The minimum performance criteria shall be 1,000 amps minimum peak delivering 4.5 coulombs within 20 milliseconds (0.020 seconds). Following exposure to this level of arcing, the sample shall be pressure-tested without leakage as defined by ANSI LC-1 sec 2.2 to 5 psi and the pressure hold for 5 minutes without signs of leakage.


**4.3.4.1 Calibration:** A test generator is configured to produce and measure the desired current waveform. An appropriately sized copper pipe is installed  $\frac{1}{8}$  inch underneath the generator's test electrode and grounded to the generator return with an AWG 6 or larger braided strap. The generator is charged to the appropriate level. The generator is then discharged through the copper pipe, and the applied current waveform is recorded. The generator is verified as producing the desired current waveform. The measured current waveform is integrated to determine the applied charge to the

89 copper pipe. The current waveform and charge transfer waveform are recorded. If the high  
90 current generator does not yield the desired current waveform or charge transfer, the generator is  
91 reconfigured, and the calibration procedures are repeated. The copper pipe is removed from the  
92 generator.

#### 93 **4.2.1 4.4.2 Testing:**

94 **4.2.1.1 4.4.2.1 Arcing Resistance:** A minimum 3-foot-long CSST test article (conditioned per 4.2) is  
95 installed at least  $\frac{1}{8}$  inch beneath a  $\frac{1}{4}$ -inch-diameter (~~maximum~~) test electrode. The electrode shall  
96 be placed at least 12 inches from the ends of the test article. The ~~brass fitting inner stainless steel~~  
97 ~~piping of the CSST~~ is grounded to the generator return using an AWG 6 ~~or larger~~ braided strap. A  
98 dielectric may be required underneath the test article to ensure the test currents flow along the length  
99 of the test article and not to the test bench or support equipment. The lightning generator is charged  
100 to the appropriate level, and is then discharged to the test article. If the test generator does not  
101 discharge to the test article, it shall be confirmed that sufficient voltage is present to achieve dielectric  
102 breakdown of the jacket (~~attachment to SS core~~) and adjustments are made accordingly. It is verified  
103 that the test current did not arc to the exposed tubing on either end of the test article. If all or a portion  
104 of the test current arced to the exposed ends of the test article, the test is invalid and must be  
105 repeated. The applied current waveform is recorded. The measured current waveform is integrated  
106 to calculate the applied charge. If the calculated applied charge is equal to or greater than the values  
107 stated in Section 4.3, the applied charge transfer is recorded. The jacket is cut away from the test  
108 article at the test location and a visual inspection of the tubing is made to determine if the stainless  
109 steel tubing is punctured. If no puncture of the tubing is noted on visual inspection, the test article  
110 shall be pressure-tested to the requirements of Section 4.3. If the test article fails visual inspection or  
111 pressure test after being subjected to the required applied charge, the test article fails. If the  
112 calculated applied charge is less than the values stated in Section 4.3, the test is performed again at  
113 a different location on the same test article, or another test article from the same production lot, until  
114 the calculated applied charge requirements are satisfied. The test article is deemed to have passed if  
115 all of the requirements are met. In order to achieve a listing to this standard, no test articles can fail  
116 this test routine. See Figure 2 for test schematic. Figure 2 would need to have one fitting connection  
117 drawn in, and attached to the ground wire on the right side as described in sec 4.2. Specimen  
118 Conditioning.

119  
120  
121  
122  
123  
124  
125  
126  
127  
128  
129  
130  
131  
132  
133  
134  
135  
136  
137  
138  
139  
140  
141  
142  
143  
144  
145  
146  
147

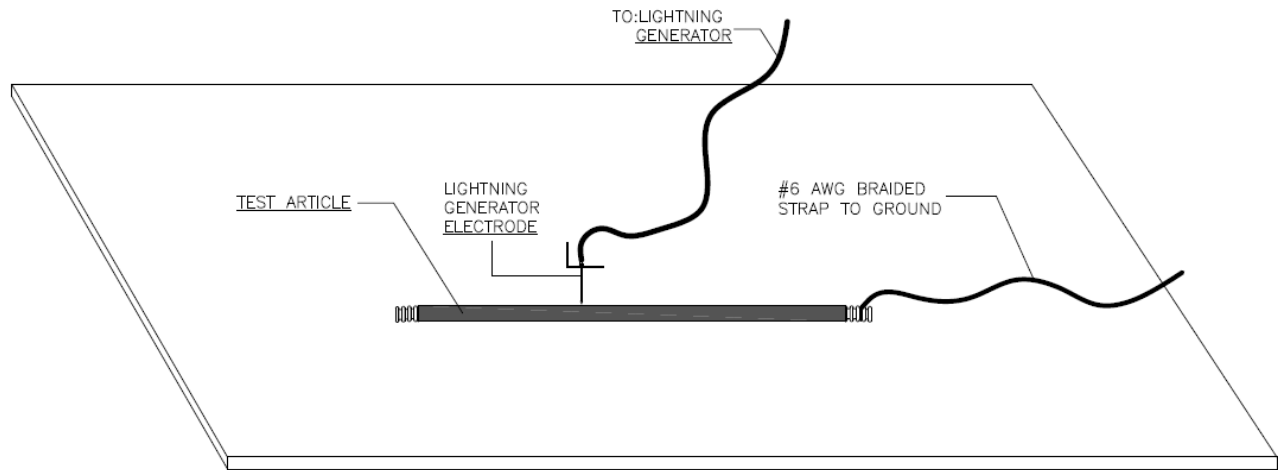

**FIGURE 2—TEST SCHEMATIC**


**4.2.1.2 4.4.2.2 Bonding Equivalence:** For the purpose of evaluating the conductive jacket for resistance to transient arcing using different bonding methods, testing in accordance with this section shall be performed using a simulated appliance consisting of:

1. A steel sheet metal chassis
2. An NPT connection point for the CSST
3. An electrical box with a minimum 10-foot-long, #14 AWG bonding conductor attached
4. A bonding clamp attached to the fitting on the free end of the CSST and a minimum 10-foot-long, #6 AWG bonding conductor

A minimum of two samples of an intermediate size of CSST shall be tested using the following configurations:

1. The #14 AWG conductor as the bond
2. The #6 AWG conductor as the bond
3. Using both as the bond

If the test results for all three configurations comply with Section 4.3.2, bonding of the conductive jacketed corrugated tubing, using a #14 AWG appliance bond, shall be deemed equivalent to using a #6 AWG bond required by IFGC 310.1.1. See Figure 3 for a test schematic.

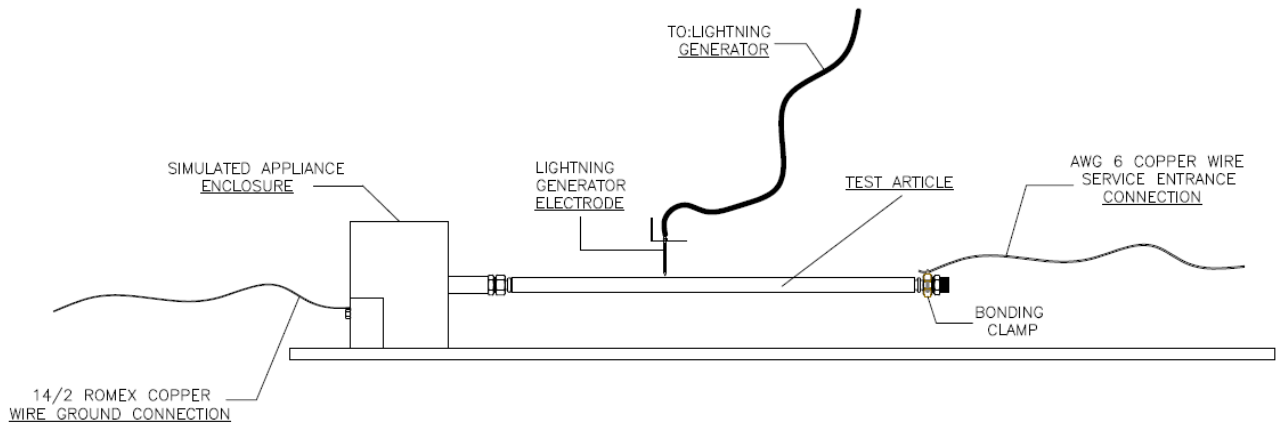

**FIGURE 3—TEST SCHEMATIC**

## 5 LISTING RECOGNITION

**5.2** Installation shall be in accordance with the manufacturer's instructions and the applicable code.

**5.3** The listing shall state that the documented level of resistance to arcing is 1000 amps minimum peak delivering 4.5 coulombs within 20 milliseconds (0.020 seconds).

**5.4** The listing shall state the covering has been tested in accordance with ASTM E 84 and meets the minimum ratings of 25 for flame spread and 50 for smoke developed.

**5.5** Upon documentation of satisfactory passing of tests noted in Section 4.3.2.2 of this criteria, the listing shall state the following: "Electrical Bonding: The Conductive Jacketed Corrugated Stainless Steel Tubing System is electrically continuous and is considered to be bonded where it is connected to appliances that are connected to the equipment grounding conductor of the circuit supplying that appliance. Additional bonding prescribed by Section 310.1.1 is not required for Conductive Jacketed Corrugated Stainless Steel Piping Systems when installed in accordance with this listing."