

ICC-ES PMG Listing**PMG-1025****Effective Date: February 1, 2009**

Revised: December 1, 2009

*This listing is subject to re-examination in one year.***www.icc-es.org/pmg | (800) 423-6587 | (562) 699-0543***A Subsidiary of the International Code Council®***CSI:** DIVISION 15—MECHANICAL
Section 15151—Air Admittance Valve**Product:** Studor Air Admittance Valves: Mini-Vent[®], Maxi-Vent[®], Tec-Vent[™] and Redi-Vent[®]**Listee:** Studor, Inc.
500 Distribution Parkway
Collierville, Tennessee 38017
www.studor.com**Additional Listees:**Ferguson Enterprises
720 Brooker Creek Blvd., Suite 205
Oldsmar, Florida 34677HD Supply
500 Distribution Parkway
Collierville, Tennessee 38017**Compliance with the following Codes:**2009 *International Plumbing Code*[®] (IPC)
2009 *International Residential Code*[®] (IRC)**Compliance with the following Standards:**ASSE 1050 - Mini-Vent[®], Maxi-Vent[®],
ASSE 1051 - Mini-Vent[®], Maxi-Vent[®], Tec-Vent[™] and Redi-Vent[®]
NSF Standard 14 - Mini-Vent[®], Maxi-Vent[®], Tec-Vent[™] and Redi-Vent[®]**Identification:**The Studor Mini-Vent[®], Maxi-Vent[®], Tec-Vent[™] and Redi-Vent[®] must be identified by molded lettering on the lid, indicating the name of the product, the manufacturer's name, manufacturing location (Collierville, Tennessee or Ellington, Connecticut), and the ICC-ES PMG listing mark.**Installation:**Studor Mini-Vent[®], Maxi-Vent[®], Tec-Vent[™] and Redi-Vent[®] must be installed in accordance with the manufacturer's installation instructions and the conditions of this listing.**Models:** The Studor Mini-Vent[®] and Maxi-Vent[®] are air admittance valves conforming to ASSE 1050, ASSE 1051 and NSF 14. The Mini-Vent[®] is designed for pipe sizes of 1¹/₂ inches through 2 inches (38 mm

through 51 mm). The Maxi-Vent[®] is designed for pipe sizes of 3 inches through 4 inches (76 mm through 102 mm).

The Studor Tec-Vent[™] and Redi-Vent[®] conforms to ASSE 1051 and NSF 14, and are designed for pipe sizes of 1½ inches through 2 inches (38 mm through 51 mm).

The Studor air admittance valves are used as a vent termination for individual vents, common vents, circuit vents and branch vents. Mini-Vent[®] and Maxi-Vent[®] are also permitted to be used as the vent termination for a vent stack or stack vent with six branch intervals or less.

Conditions of Listing:

1. The Studor Mini-Vent[®] is supplied with a connector which enables the valve to be solvent cemented onto 1½-inch- or 2-inch-diameter (38 mm or 51 mm) pipes or screwed into 1½-inch (38 mm) I.P.S. threads.
2. The Studor Maxi-Vent[®] is supplied with a synthetic rubber connector which enables the valve to be push fitted into a 4-inch-diameter (102 mm) PVC, cast iron or ABS pipe. It may also be installed on a 3-inch-diameter (76 mm) PVC, cast iron or ABS pipe in accordance with the manufacturer's instructions.
3. The Studor Tec-Vent[™] must be screwed into 1½-inch (38 mm) threads.
4. The use of Studor Mini-Vent[®], Maxi-Vent[®], Tec-Vent[™] and Redi-Vent[®] is limited to systems subject to siphonage conditions and a maximum pressure condition of 1-inch (25 mm) water column.
5. Each Studor Mini-Vent[®], Maxi-Vent[®], Tec-Vent[™] and Redi-Vent[®] must be located a minimum of 4 inches (102 mm) above the weir of the fixture trap when providing trap seal protection for fixtures or branches. When serving as vent terminals for stack vents or vent stacks, they must be a minimum of 6 inches (152 mm) above the flood level rim of the highest fixture served.
6. Each Studor Mini-Vent[®], Maxi-Vent[®], Tec-Vent[™] and Redi-Vent[®] must be accessible for service, repair or replacement.
7. The Studor Mini-Vent[®], Maxi-Vent[®], Tec-Vent[™] and Redi-Vent[®] must be located to allow adequate air to enter the valve. When the products are located in a wall space or attic space, ventilation openings must be provided into the space. When in an attic space, the vents must be located a minimum of 6 inches (152 mm) above any ceiling insulation.
8. The air-admittance valve must be installed in the vertical upright position. The maximum offset from the vertical upright position must not exceed 15 degrees.
9. Each vent must connect to the drain with a vertical connection to maintain an unblocked opening in the piping to the air admittance valves.
10. A minimum of one vent stack or stack vent must extend outdoors to the open air for every building plumbing drainage system unless specifically engineered.
11. The Studor Tec-Vent[™] and Redi-Vent[®] must only be installed as a branch vent terminal for fixtures on the same floor.
12. The Studor Mini-Vent[®] and Maxi-Vent[®] are permitted to be installed as the vent termination for a vent stack or stack vent with six branch intervals or less or as a branch vent terminal for fixtures on the same floor.
13. The air admittance valves must be installed after the drainage system has been pressure tested.
14. When a horizontal branch connects to a stack more than four branch intervals from the top of the stack, a relief vent must be provided. The relief vent must be located between the connection of the branch to the stack and the first fixture connecting to the branch. The relief vent may also serve as a vent for a single fixture. The relief vent must connect to the vent stack or stack vent and extend to the open air outside the building.

15. The Studor Mini-Vent®, Maxi-Vent®, Tec-Vent™ and Redi-Vent® are produced in Ellington, Connecticut, and Collierville, Tennessee, under annual surveillance audits by NSF International (AA-633).









TABLE 1—AIR ADMITTANCE VALVE CROSS REFERENCE OF MODEL NUMBERS, STUDOR AND FERGUSON

STUDOR/IPS MODEL NO.	STUDOR/IPS PART NO.	DESCRIPTION	FERGUSON PART NO.	FERGUSON MODEL NO.
20305	20305	X-Pack Mini-Vent PVC (40 pack)	20505	PFS20305
20336	20336	X-Pack Minis ABS (40 pack)	20538	PFS20336
20300	20300	MINI VENT - ABS (24 pack)	20500	PFS20300
20301	20301	MINI VENT - PVC (24 pack)	20501	PFS20301
20302	20302	MAXI VENT USA PVC (25 pack)	20502	PFS20302
20386	20386	REDI-VENT PVC (120 Pack)	20586	PFS20386
20389	20389	REDI-VENT ABS (120 Pack)	20589	PFS20389


TABLE 2—AIR ADMITTANCE VALVE CROSS REFERENCE OF MODEL NUMBERS, STUDOR AND HD SUPPLY

STUDOR/IPS MODEL NO.	STUDOR/IPS PART NO.	DESCRIPTION	HD PART NO.	HD MODEL NO.
20302	20302	MAXI VENT USA (25 pack)	91555	BR10464
20305	20305	X-Pack Mini-Vent PVC (40 pack)	91556	BR10465
20336	20336	X-Pack Mini-Vent ABS (40 pack)	91557	BR10466
20386	20386	REDI-VENT PVC (60 Pack)	91560	BR10469
20389	20389	REDI-VENT ABS (60 Pack)	91561	BR10470

The following diagrams are examples of acceptable designs using the Studor Mini-Vent®, Maxi-Vent® and Tec-Vent™:
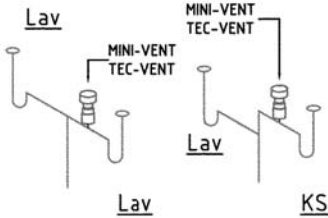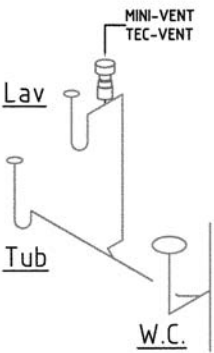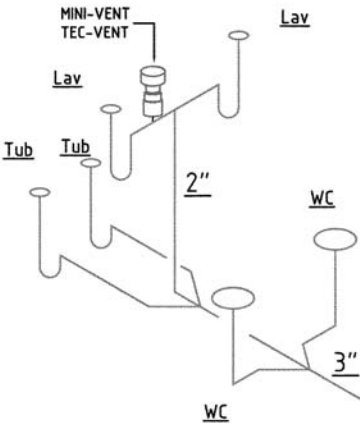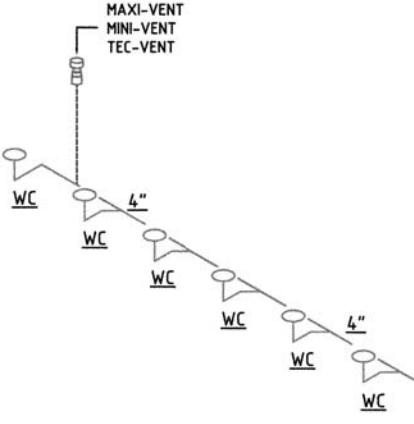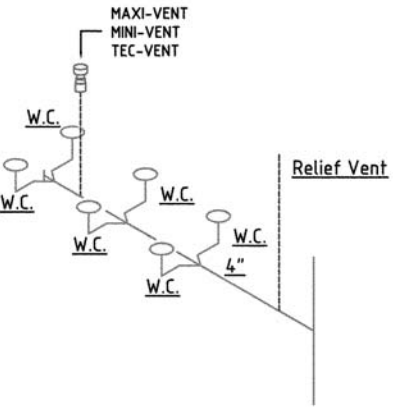
<p style="text-align: center;"><u>Individual Vent</u></p>  <p>The air admittance valve must be located a minimum of 4" above the weir of the trap. However, the valve may be located below the flood rim level of the fixture being vented.</p>  <p style="text-align: center;"><u>Figure 1</u></p>	<p style="text-align: center;"><u>Common Vent</u></p>  <p>A common vent is similar to an individual vent. The vent serves two(2) fixtures. The Studor Mini-Vent or Tec-Vent can be located in the proximity to the fixtures being served.</p>  <p style="text-align: center;"><u>Figure 2</u></p>	<p style="text-align: center;"><u>Wet Vent</u></p>  <p>A wet vent is a single vent for one or two bathroom groups. There are different layouts for achieving the venting concept.</p> <p>A single bathroom group wet vent can be vented to a Studor Mini-Vent or Tec-Vent.</p> <p style="text-align: center;"><u>Figure 3</u></p>
<p style="text-align: center;"><u>Back To Back Wet Vent</u></p>  <p>A double bathroom group, back to back, can be wet vented with a single Studor Mini connecting as the vent.</p> <p style="text-align: center;"><u>Figure 4</u></p>	<p style="text-align: center;"><u>Circuit Vent</u></p>  <p>A single vent serves as the vent for three to eight fixtures. The Studor Mini, Tec-Vent or Maxi-Vent serves as the vent for the circuit vent. See Figure 6 for the relief vent requirement.</p> <p style="text-align: center;"><u>Figure 5</u></p>	<p style="text-align: center;"><u>Circuit Vent With Relief Vent</u></p>  <p>When the horizontal drainage branch connects to a stack having more than four branch intervals located above the branch, a relief vent is required. A relief vent is also required for branches receiving discharge from 4 or more water closets. The relief vent must connect to the vent stack or stack vent and extend to the outdoor air.</p> <p style="text-align: center;"><u>Figure 6</u></p>

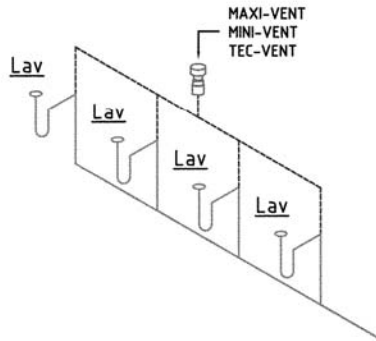
Branch Vent



When various vents connects to a branch vent, a single Studor Mini-Vent, Tec-Vent or Maxi-Vent can serve as the vent for the branch vent.

Figure 7

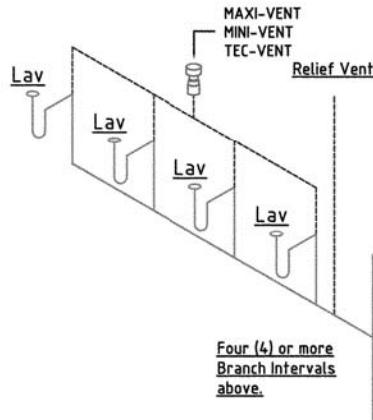
Branch Vent



More than one Studor Mini-Vent can be installed within a horizontal branch to vent various fixtures. A relief vent is required when more than four (4) branch intervals are located above the branch connection.

Figure 8

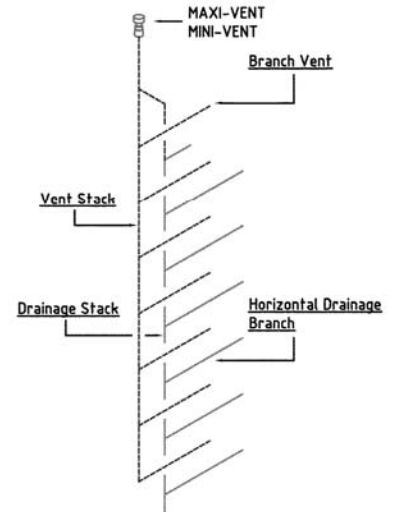
Vent Stack-Stack Vent



The stack type air admittance valve, Studor Maxie-Vent or Mini-Vent, can serve as the vent terminal for a vent stack or stack vent. The maximum height of the drainage stack that is vented with an air admittance valve is six branch intervals.

Figure 9

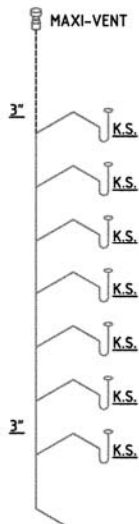Waste Vent Stack



The Studor Maxi-Vent or Mini-Vent, can serve as the vent for a waste stack. The maximum height of the waste stack that is vented with an air admittance valve is six branch intervals.

Figure 10